

LINETRAXX® RCMA423AS

AC/DC sensitive residual current monitor for monitoring AC-, DC- and pulsed DC currents in TN- and TT systems (acc. norm AS/NZS 2081:2011)





LINETRAXX® RCMA423AS

Device features

- AC/DC sensitive residual current monitor Type B acc. AS/NZS 2081:2011
- r.m.s. value measurement (AC+DC)
- Two separately adjustable response values 100 mA...5 A
- Frequency range 0...1000 Hz
- Start-up delay, response delay and delay on release
- Digital measured value display via LC display
- Measured value memory for operating value
- CT connection monitoring
- LEDs: Power On, Alarm 1, Alarm 2
- Internal/external test/reset button
- Two separate alarm relays (one changeover contact each)
- N/O or N/C operation and fault memory selectable
- Continuous self monitoring
- Multi-functional LC display
- Password protection for device settings
- Sealable transparent cover
- Push-wire terminal (two terminals per connection)
- Two-module enclosure (36 mm)

Approvals

AS/NZS 2081:2011

Product description

The AC/DC sensitive residual current monitor RCMA423AS is designed for monitoring earthed power supply systems (TN and TT systems) where smooth DC fault currents or residual currents continuously greater than zero may occur. These are in particular loads containing six-pulse rectifiers or one way rectifiers with smoothing, such as converters, battery chargers, construction site equipment with frequency-controlled drives. Currents in single conductors can also be monitored by RCMA423AS.

The prewarning stage (50...100 % of the set response value $I_{\Delta n2}$) allow to distinguish between prewarning and alarm. Since the values are measured with measuring current transformers, the device is nearly independent of the load current and the nominal voltage of the system.

Applications

- AC/DC sensitive residual current monitoring in earthed two, three or four conductor systems (TN and TT systems)
- AC/DC sensitive residual current monitor for mining according to AS/NZS 2081:2011
- Monitoring of variable-speed drives, UPS systems, construction site equipment, printing machines, battery systems, laboratory equipment, wood working machines, MF welding systems, furniture industry, medical electrical equipment, etc.
- AC/DC sensitive current monitoring of, in the normal case, de-energised single conductors (e.g. N conductors)

Function

Once the supply voltage U_S is applied, the start-up delay is activated. Measured values changing during this time do not influence the switching state of the alarm relays.


Residual current monitoring takes place via a flexible external measuring current transformer. The actual measured value is indicated on the LCD. In this way any changes, for example when circuits are connected to the system, can be recognised easily. If the measured value exceeds the set response values, the response delays $t_{on1/2}$ begin. Once the response delay $t_{on1/2}$ has elapsed, the K1/K2 alarm relays switch and the alarm LEDs AL1/AL2 light up. If the current falls below the release value (response value plus hysteresis), the release delay t_{off} begins. When t_{off} has elapsed, the alarm relays return to their initial position and the alarm LEDs AL1/AL2 go out. If the fault memory is activated, the alarm relays remain in the alarm state and the LEDs light until the reset button is pressed or until the supply voltage is interrupted. The device function can be tested using the test button. Parameters are assigned to the device via the LCD and the control buttons on the front panel; this function can be password-protected.

Connection monitoring

The function of the device and the CT connections are continuously monitored. In the event of a fault, the alarm relays K1/K2 switch without delay, the alarm LEDs AL1/AL2/ON flash. On removal of the fault, the alarm relays return to their initial position either automatically or by pressing the reset button.




Operating and display elements

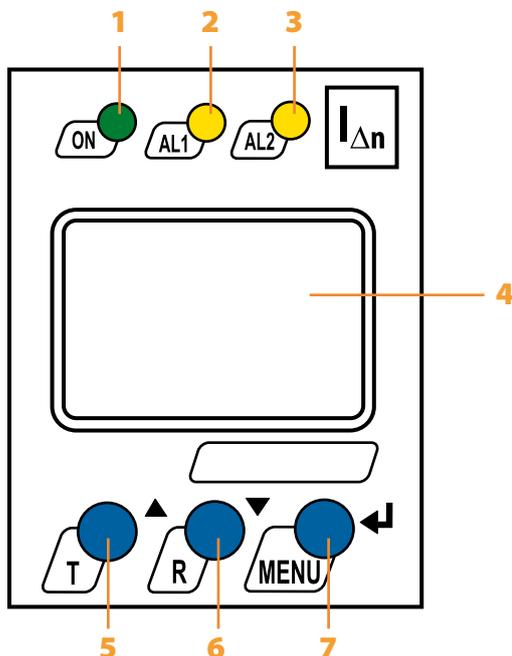

- 1 - Power On LED "ON" (green); lights when supply voltage is applied and flashes in the event of system fault alarm respectively in the event of CT malfunction
- 2 - Alarm LED "AL1" (yellow), prewarning; lights when the set response value $I_{\Delta n1}$ is exceeded or flashes in the event of system fault alarm respectively in the event of CT malfunction
- 3 - Alarm LED "AL2" (yellow), alarm; lights when the set response value $I_{\Delta n2}$ is exceeded or flashes in the event of system fault alarm respectively in the event of CT malfunction
- 4 - Multi-functional LC display
- 5 - Test button "T": to call up the self test.
Arrow up button: parameter change, to move up in the menu
- 6 - Reset button "R": to delete saved alarms.
Arrow down button: parameter change, to move down in the menu
- 7 - "MENU" button: to call up the menu system.
Enter button: to confirm parameter change.
"ESC" button: press the button > 1.5 seconds.



Wiring diagram

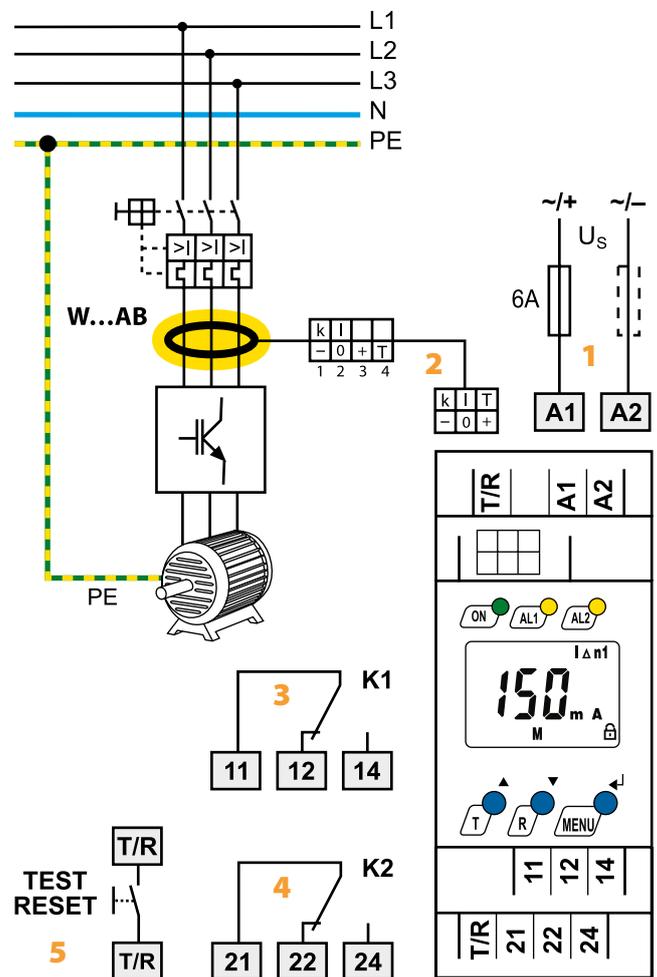

- 1 - Supply voltage U_S see ordering information, 6 A fuse recommended
- 2 - Connector for the external W20AB...W210AB series measuring current transformer
- 3 - Alarm relay "K1": $I_{\Delta n1}$ (prewarning)
- 4 - Alarm relay "K2": alarm $I_{\Delta n2}$ (alarm)
- 5 - Combined test and reset button "T/R"
short-time pressing (< 1.5 s) = RESET
long-time pressing (> 1.5 s) = TEST

Do not route the PE conductor through the measuring current transformer!

Connection of measuring current transformers

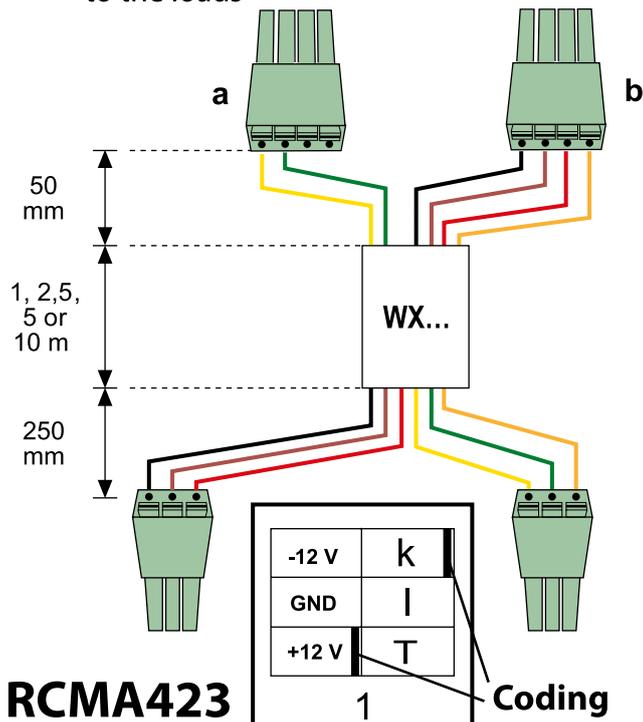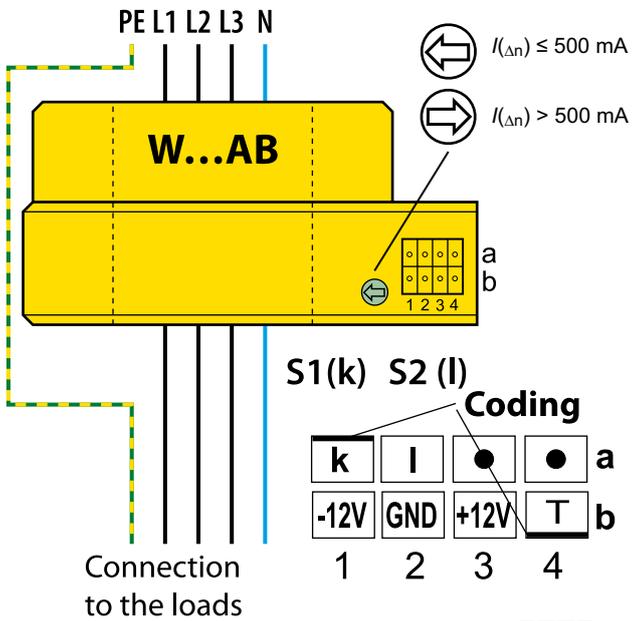

RCMA423

Connection to the RCMA423AS residual current monitor using the WX-... connecting cable.

Colour coding for WX...: k = yellow, I = green, -12 V = black, GND = brown, +12 V = red, Test (T) = orange

Residual operating current ranges of the different measuring current transformers

Residual operating current ranges	Type
10 mA...500 mA	W20AB
10 mA...10 A	W35AB(P); W60AB(P); W120 AB
300 mA...10 A	W210AB


Dimension diagram XM420

Dimensions in mm

Open the front plate cover in direction of arrow!

Screw mounting

Note: The upper mounting clip must be ordered separately (see ordering information).

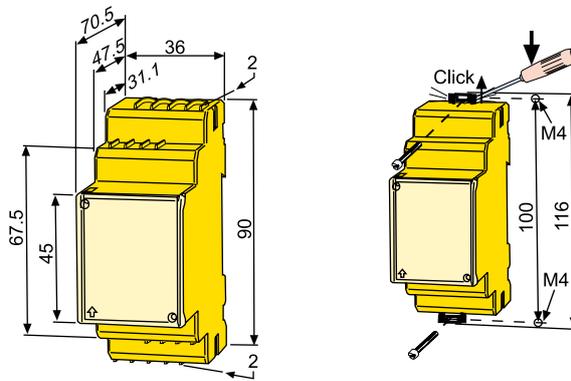

Ordering information

Supply voltage ¹⁾ U _S		Type	Art. No.
AC	DC		
16...72 V, 42...460 Hz	9.6...94 V	RCMA423AS-D-1	B 7404 3045
70...300 V, 42...460 Hz	70...300 V	RCMA423AS-D-2	B 7404 3046

Device version with screw terminals on request.

¹⁾ Absolute values

Accessories

Type designation	Art. No.
Mounting clip for screw mounting (1 piece per device)	B 9806 0008

Suitable system components

Type designation	Internal diameter (mm)	Type	Art. No.
Measuring current transformers	ø 20	W20AB	B 9808 0008
		W35AB	B 9808 0016
	ø 35	W35ABP	B 9808 0051
		W60AB	B 9808 0026
	ø 60	W60ABP	B 9808 0052
		ø 120	W120AB
	ø 210	W210AB	B 9808 0040

Type designation	Length/m	Type	Art. No.
Connection cable measuring current transformer	1	WX-100	B 9808 0503
	2,5	WX-250	B 9808 0504
	5	WX-500	B 9808 0505
	10	WX-1000	B 9808 0506

Technical data
Insulation coordination acc. to IEC 60664-1/IEC 60664-3
RCMA423AS-D-1:

Rated insulation voltage	100 V
Overtoltage category/ pollution degree	III/3
Rated impulse voltage	2.5 kV

RCMA423AS-D-2:

Rated insulation voltage	250 V
Overtoltage category/ pollution degree	III/3
Rated impulse voltage	4 kV

Supply voltage
RCMA423AS-D-1:

Supply voltage range U_S (acc. AS/NZS 2081:2011)	AC 32...60 V/DC 19,2...78 V
Operating range U_S	AC 16...72 V/DC 9,6...94 V
Frequency range U_S	DC, 42...460 Hz

RCMA423AS-D-2:

Supply voltage range U_S (acc. AS/NZS 2081:2011)	AC/DC 140...250 V
Operating range U_S	AC/DC 70...300 V
Frequency range U_S	DC, 42...460 Hz

Protective separation (reinforced insulation) between (A1, A2) - (k/I, T/R) - (11, 12, 14) - (21, 22, 24)	
Voltage test according to IEC 61010-1	2.5 kV/1 Min.
Power consumption	≤ 6,5 VA

Measuring circuit

External measuring current transformer W20AB, W35AB(P), W60AB(P), W120AB, W210AB series	
Rated insulation voltage (measuring current transformer)	800 V
Rated frequency	0...1000 Hz
Relative uncertainty for $f \leq 2$ Hz or ≥ 30 Hz	±10 %
Relative uncertainty for $f > 2... < 30$ Hz	-35...100 %

Response values

Rated residual operating current $I_{\Delta n1}$ (prewarning, AL1)	50...100 % of $I_{\Delta n2}$ (50 %)*
Rated residual operating current $I_{\Delta n2}$ (alarm, AL2)	100 mA...5 A (100 mA)*
Hysteresis	10...25 % (15%)*

Specified time

Start-up delay t	0...10 s (0.5 s)*
Response delay t_{on1}	0...10 s (0 s)*
Response delay t_{on1} (alarm)	0...10 s (0 s)*
Delay on release t_{off}	0...300 s (1 s)*

The actuating times depend on the rated frequency:

Operating time t_{ae} at $I_{\Delta n} = 1 \times I_{\Delta n1/2}$ ($\geq 50... \leq 1000$ Hz)	≤ 50 ms
Operating time t_{ae} at $I_{\Delta n} = 2 \times I_{\Delta n1/2}$ (< 50 Hz)	≤ 50 ms
Response time t_{an}	$t_{an} = t_{ae} + t_{on1/2}$
Recovery time t_b	≤ 300 ms

Displays, memory

Display range, measured value AC/DC	0...9.6 A
Error of indication	±17.5 %/± 2 digit
Measured-value memory for alarm value	data record measured values
Password	off/0...999 (off)*
Fault memory alarm relay	on

Inputs/outputs

Cable length for external test/reset button	0...10 m
---	----------

Cable lengths for measuring current transformers

Connection WX...	1 m/2.5 m/5 m/10 m
or alternatively: single wire 6 x 0.75 mm ²	0...10 m

Switching elements

Number of switching elements	2 x 1 changeover contact
Operating principle	N/C operation/N/O operation (N/C operation)*
Electrical endurance, number of cycles	10000
Contact data acc. to AS/NZS 2081:2011:	
Utilisation category	AC-13 AC-14 DC-12 DC-12 DC-12
Rated operational voltage	230 V 230 V 24 V 110 V 220 V
Rated operational current	1 A 0,6 A 0,2 A 40 mA 20 mA
Minimum contact rating	1 mA at AC/DC ≥ 10 V

Environment/EMC

EMC	IEC 62020, AS/NZS 2081: 2011
Operating temperature	-25 °C...+55 °C
Classification of climatic conditions IEC 60721	
Stationary use (IEC 60721-3-3)	3K5 (except condensation and formation of ice)
Transportation (IEC 60721-3-2)	2K3 (except condensation and formation of ice)
Storage (IEC 60721-3-1)	1K4 (except condensation and formation of ice)
Classification of mechanical conditions acc. to IEC 60721:	
Stationary use (IEC 60721-3-3)	3M4
Transportation (IEC 60721-3-2)	2M2
Storage (IEC 60721-3-1)	1M3

Connection

Connection type	push-wire terminals
Connection properties:	
Rigid	0.2...2.5 mm ² (AWG 24...14)
Flexible without ferrules	0.75...2.5 mm ² (AWG 19...14)
Flexible with ferrules	0.2...1.5 mm ² (AWG 24...16)
Stripping length	10 mm
Opening force	50 N
Test opening, diameter	2.1 mm

Other

Operating mode	continuous operation
Position of normal use	display-oriented
Degree of protection, internal components (IEC 60529)	IP30
Degree of protection, terminals (IEC 60529)	IP20
Enclosure material	polycarbonate
Flammability class	UL94V-0
DIN rail mounting acc. to	IEC 60715
Screw mounting	2 x M4 with mounting clip
Documentation number	D00157
Weight	≤ 150 g

(*) = factory setting



Bender GmbH & Co. KG

P.O. Box 1161 • 35301 Gruenberg • Germany
Londorfer Strasse 65 • 35305 Gruenberg • Germany
Tel.: +49 6401 807-0 • Fax: +49 6401 807-259
E-Mail: info@bender.de • www.bender.de



BENDER Group